
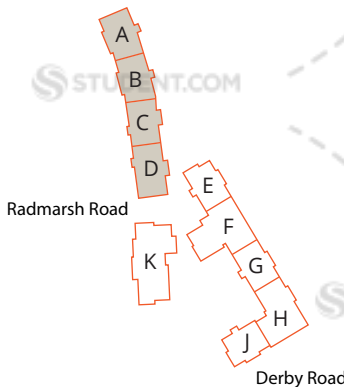


Riverside Point
Radmarsh Road,
Lenton, Nottingham
NG7 2GJ

GROUND FLOOR

KEY

- Smoke Detector
- Smoke Detector Sounder
- Smoke Detector Sounder Beacon
- Heat Detector
- Heat Detector Sounder
- Heat Detector Sounder Beacon
- Multi-Sensor Detector
- Multi-Sensor Detector Sounder
- Fire Alarm Call Point
- Fire Alarm Beacon
- Fire Alarm Control Panel
- Fire Alarm Repeater Panel
- Fire Alarm Interface Unit
- Wall Mounted Sounder
- Wall Mounted Sounder Beacon
- Automatic Opening Vent Control Panel
- Automatic Opening Vent
- Automatic Opening Vent Call Point
- Manual Opening Vent
- Dry Riser Landing Valve Outlet
- Dry Riser Inlet
- Wet Riser Landing Valve Outlet
- Wet Riser Inlet
- Water Tank
- CO2 Extinguisher
- Water Extinguisher
- Dry Powder Extinguisher
- Foam Extinguisher
- Wet Chemical Extinguisher
- Fire Blanket
- Fire Fighting Lift
- FD30s Fire Door
- FD60s Fire Door
- FD90s Fire Door
- Fire Resistant Glazing
- Emergency Light Unit
- Gas Shut Off Valve
- Electrical Distribution Board
- Electrical Intake Board
- Fire Hydrant
- Emergency Voice Comms
- EVCS Control Panel
- 30 Minutes Compartmentation
- 60 Minutes Compartmentation
- 90 Minutes Compartmentation
- 120 Minutes Compartmentation


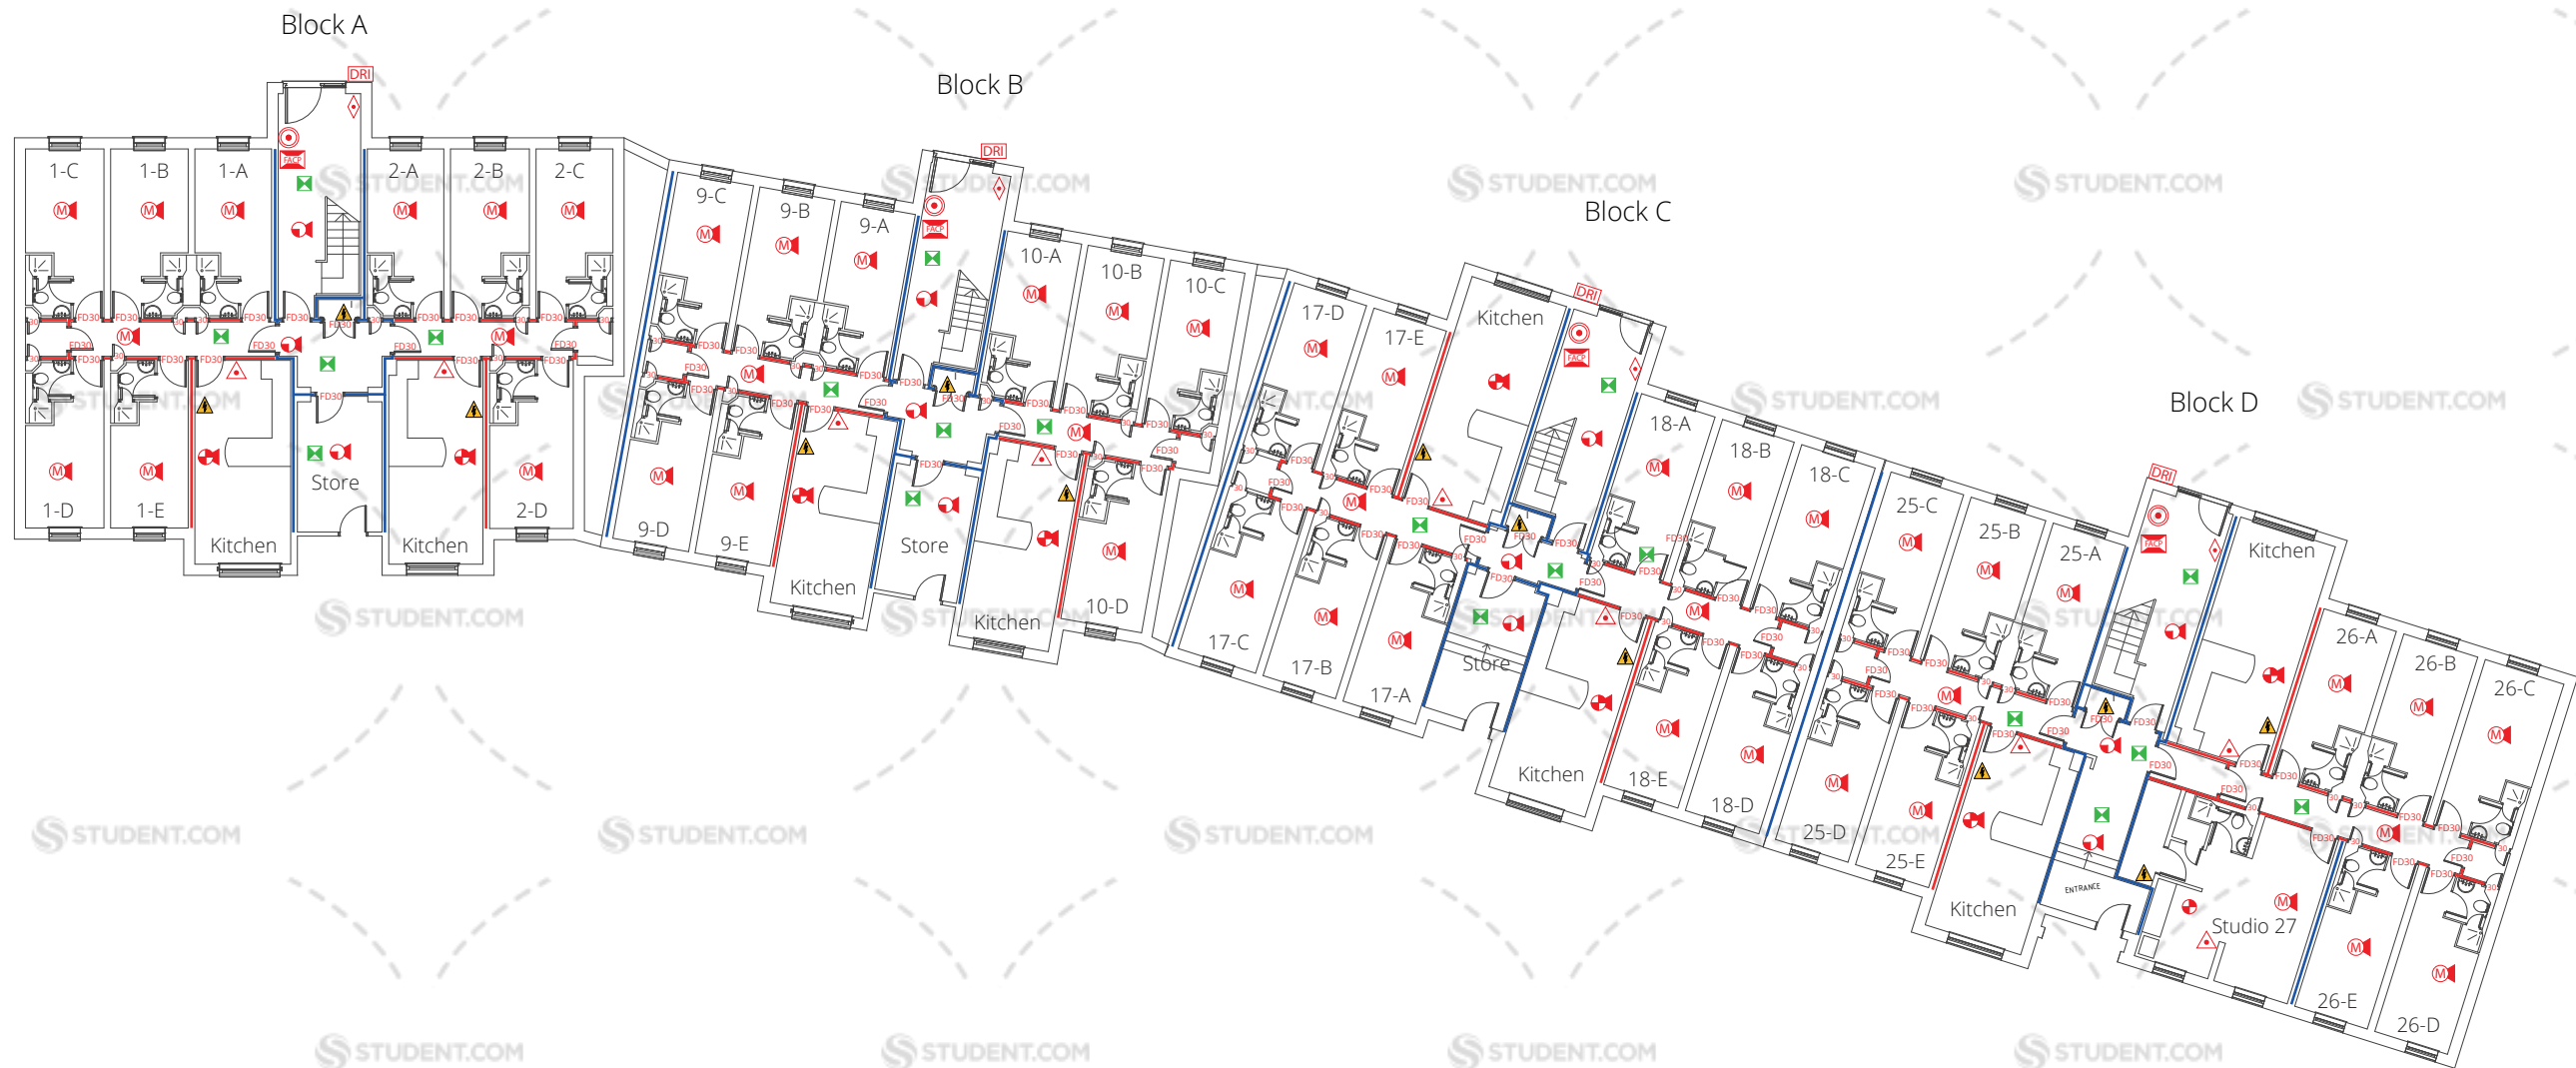


Riverside Point
Radmarsh Road,
Lenton, Nottingham
NG7 2GJ

FIRST FLOOR

KEY

- Smoke Detector
- Smoke Detector Sounder
- Smoke Detector Sounder Beacon
- Heat Detector
- Heat Detector Sounder
- Heat Detector Sounder Beacon
- Multi-Sensor Detector
- Multi-Sensor Detector Sounder
- Fire Alarm Call Point
- Fire Alarm Beacon
- Fire Alarm Control Panel
- Fire Alarm Repeater Panel
- Fire Alarm Interface Unit
- Wall Mounted Sounder
- Wall Mounted Sounder Beacon
- Automatic Opening Vent Control Panel
- Automatic Opening Vent
- Automatic Opening Vent Call Point
- Manual Opening Vent
- Dry Riser Landing Valve Outlet
- Dry Riser Inlet
- Wet Riser Landing Valve Outlet
- Wet Riser Inlet
- Water Tank
- CO2 Extinguisher
- Water Extinguisher
- Dry Powder Extinguisher
- Foam Extinguisher
- Wet Chemical Extinguisher
- Fire Blanket
- Fire Fighting Lift
- FD30s Fire Door
- FD60s Fire Door
- FD90s Fire Door
- Fire Resistant Glazing
- Emergency Light Unit
- Gas Shut Off Valve
- Electrical Distribution Board
- Electrical Intake Board
- Fire Hydrant
- Emergency Voice Comms
- EVCS Control Panel
- 30 Minutes Compartmentation
- 60 Minutes Compartmentation
- 90 Minutes Compartmentation
- 120 Minutes Compartmentation

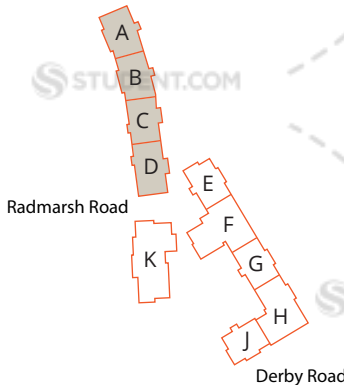
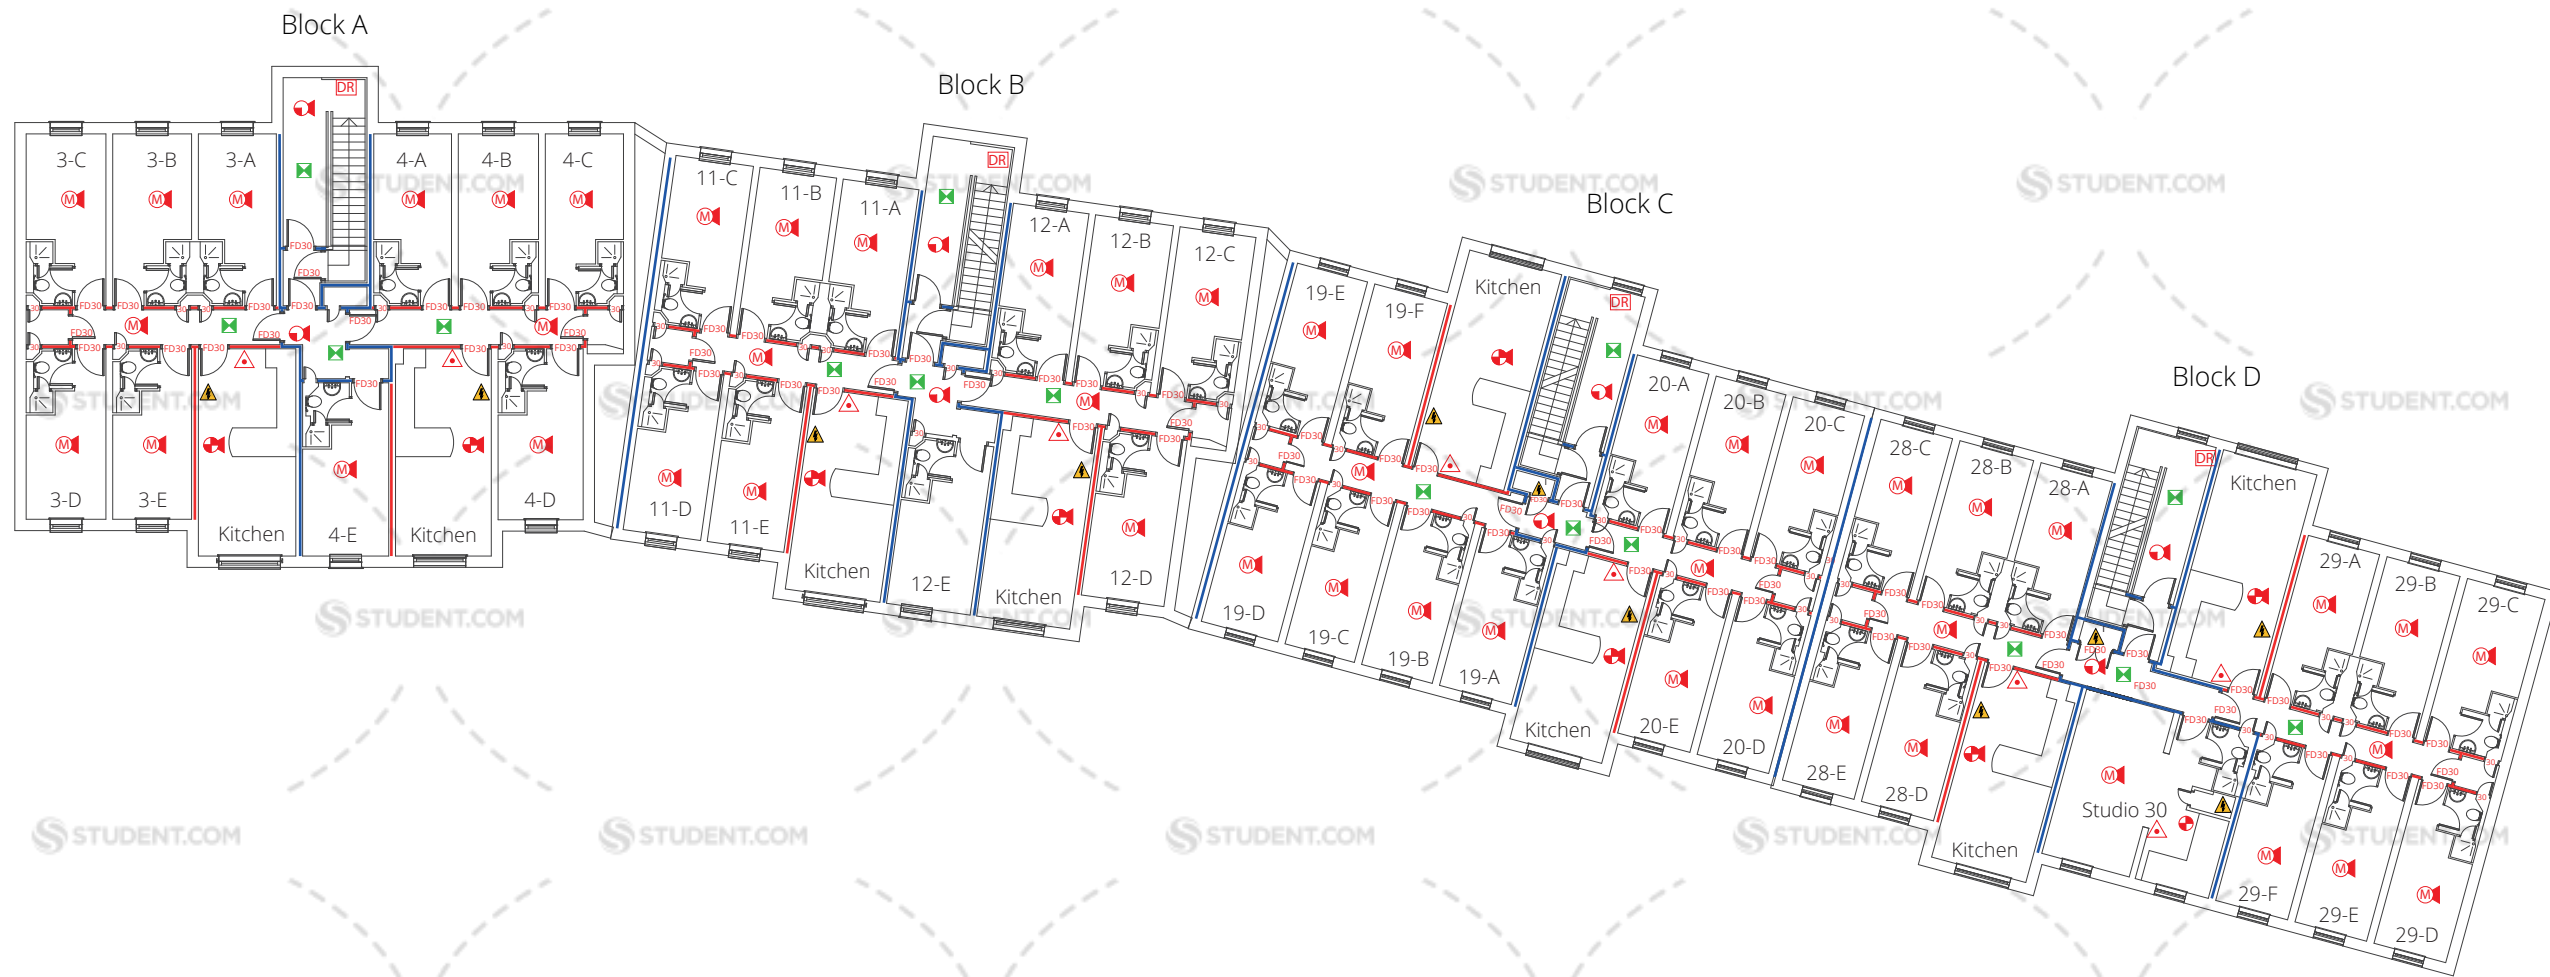


Riverside Point
Radmarsh Road,
Lenton, Nottingham
NG7 2GJ

SECOND FLOOR

KEY

- Smoke Detector
- Smoke Detector Sounder
- Smoke Detector Sounder Beacon
- Heat Detector
- Heat Detector Sounder
- Heat Detector Sounder Beacon
- Multi-Sensor Detector
- Multi-Sensor Detector Sounder
- Fire Alarm Call Point
- Fire Alarm Beacon
- Fire Alarm Control Panel
- Fire Alarm Repeater Panel
- Fire Alarm Interface Unit
- Wall Mounted Sounder
- Wall Mounted Sounder Beacon
- Automatic Opening Vent Control Panel
- Automatic Opening Vent
- Automatic Opening Vent Call Point
- Manual Opening Vent
- Dry Riser Landing Valve Outlet
- Dry Riser Inlet
- Wet Riser Landing Valve Outlet
- Wet Riser Inlet
- Water Tank
- CO2 Extinguisher
- Water Extinguisher
- Dry Powder Extinguisher
- Foam Extinguisher
- Wet Chemical Extinguisher
- Fire Blanket
- Fire Fighting Lift
- FD30s Fire Door
- FD60s Fire Door
- FD90s Fire Door
- Fire Resistant Glazing
- Emergency Light Unit
- Gas Shut Off Valve
- Electrical Distribution Board
- Electrical Intake Board
- Fire Hydrant
- Emergency Voice Comms
- EVCS Control Panel
- 30 Minutes Compartmentation
- 60 Minutes Compartmentation
- 90 Minutes Compartmentation
- 120 Minutes Compartmentation

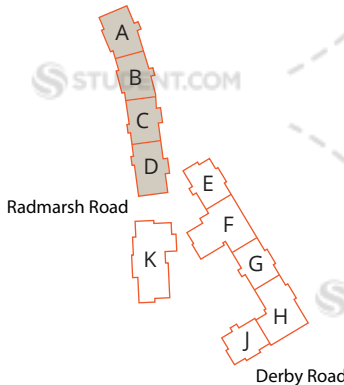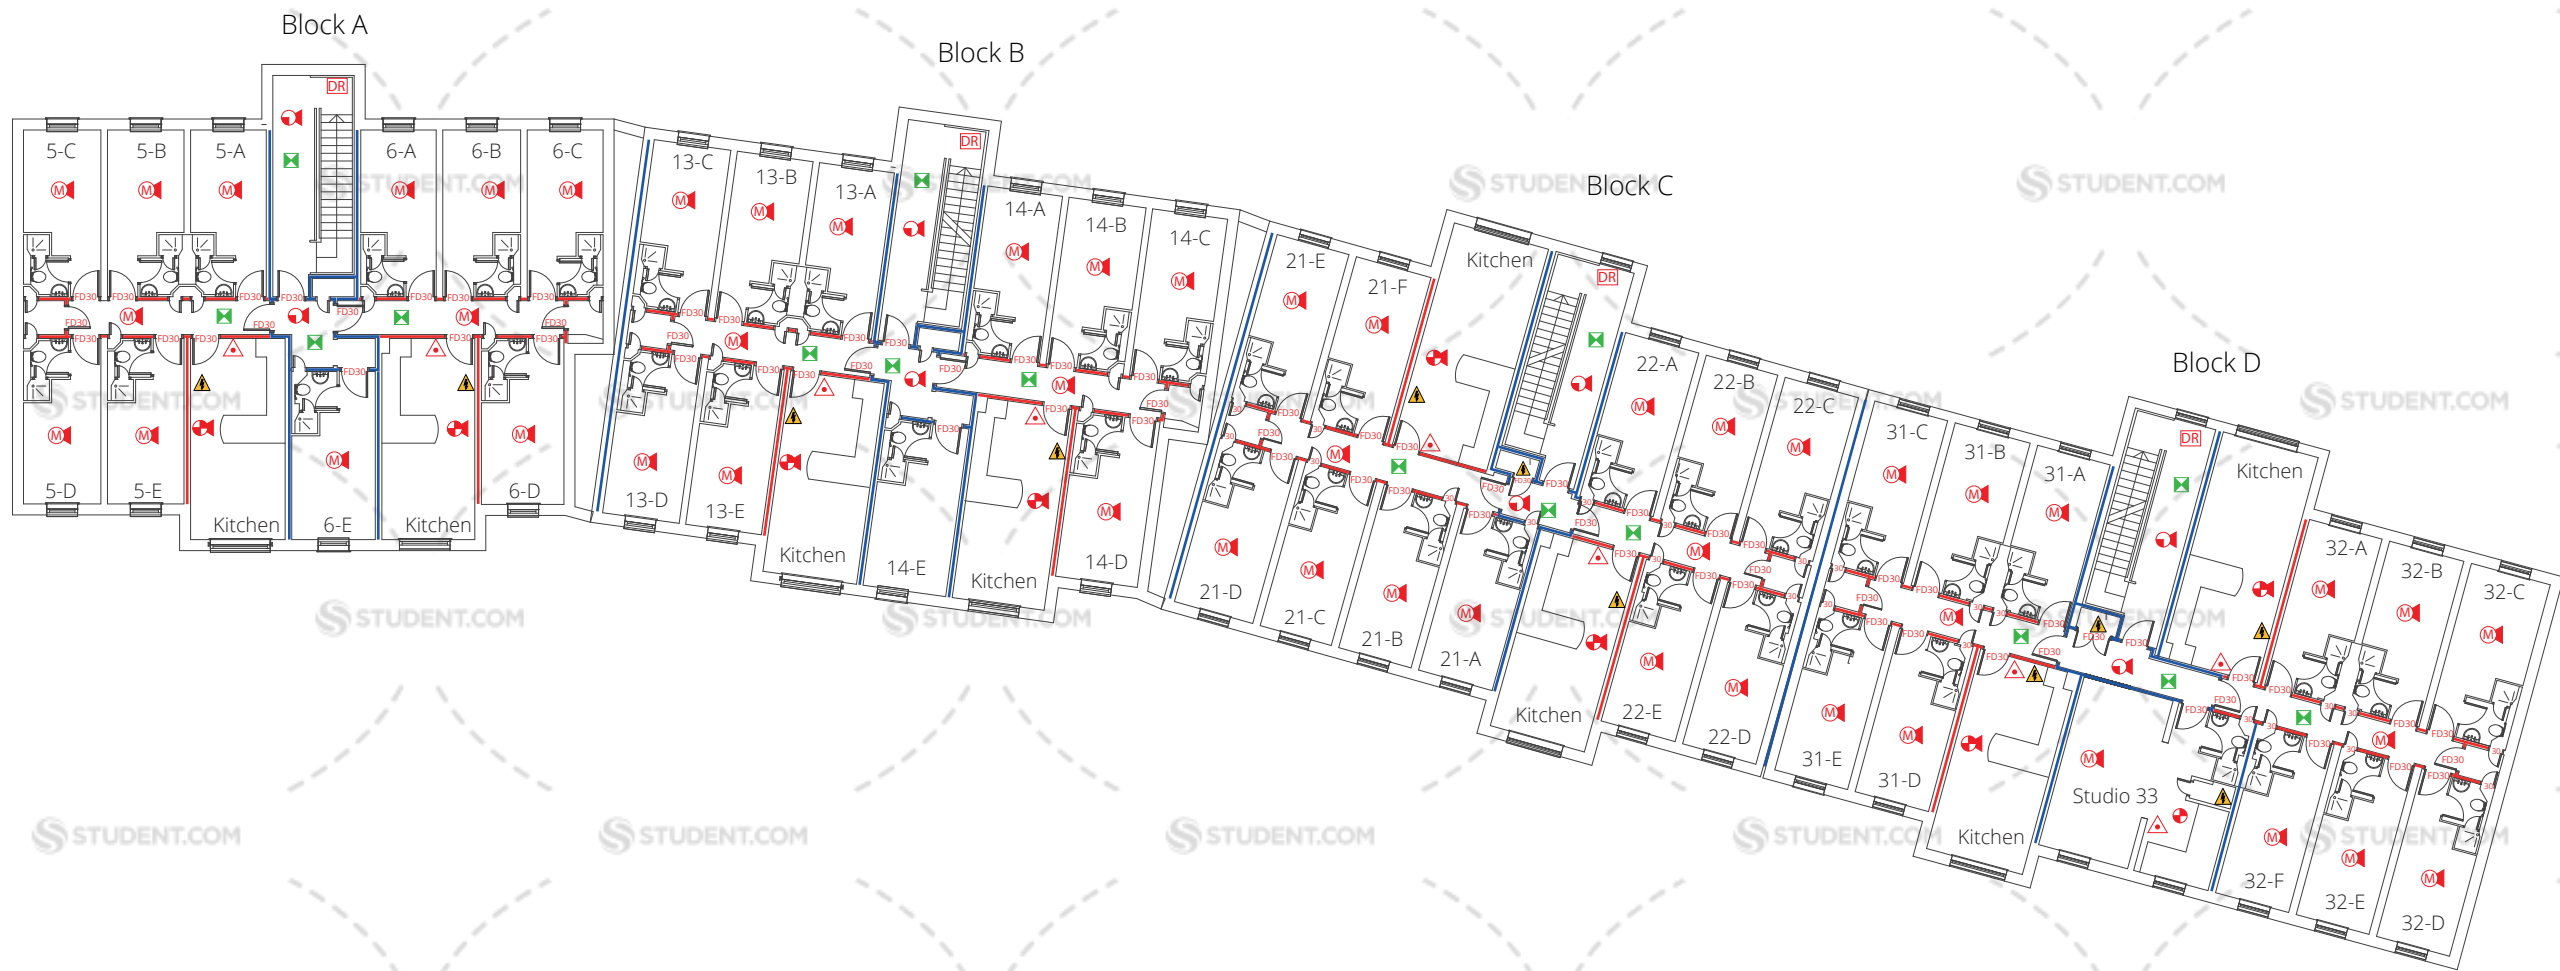

Riverside Point
Radmarsh Road,
Lenton, Nottingham
NG7 2GJ

THIRD FLOOR

KEY

- Smoke Detector
- Smoke Detector Sounder
- Smoke Detector Sounder Beacon
- Heat Detector
- Heat Detector Sounder
- Heat Detector Sounder Beacon
- Multi-Sensor Detector
- Multi-Sensor Detector Sounder
- Fire Alarm Call Point
- Fire Alarm Beacon
- Fire Alarm Control Panel
- Fire Alarm Repeater Panel
- Fire Alarm Interface Unit
- Wall Mounted Sounder
- Wall Mounted Sounder Beacon
- Automatic Opening Vent Control Panel
- Automatic Opening Vent
- Automatic Opening Vent Call Point
- Manual Opening Vent
- Dry Riser Landing Valve Outlet
- Dry Riser Inlet
- Wet Riser Landing Valve Outlet
- Wet Riser Inlet
- Water Tank
- CO2 Extinguisher
- Water Extinguisher
- Dry Powder Extinguisher
- Foam Extinguisher
- Wet Chemical Extinguisher
- Fire Blanket
- Fire Fighting Lift
- FD30s Fire Door
- FD60s Fire Door
- FD90s Fire Door
- Fire Resistant Glazing
- Emergency Light Unit
- Gas Shut Off Valve
- Electrical Distribution Board
- Electrical Intake Board
- Fire Hydrant
- Emergency Voice Comms
- EVCS Control Panel
- 30 Minutes Compartmentation
- 60 Minutes Compartmentation
- 90 Minutes Compartmentation
- 120 Minutes Compartmentation



Riverside Point
Radmarsh Road,
Lenton, Nottingham
NG7 2GJ

GROUND FLOOR

KEY

- Smoke Detector
- Smoke Detector Sounder
- Smoke Detector Sounder Beacon
- Heat Detector
- Heat Detector Sounder
- Heat Detector Sounder Beacon
- Multi-Sensor Detector
- Multi-Sensor Detector Sounder
- Fire Alarm Call Point
- Fire Alarm Beacon
- Fire Alarm Control Panel
- Fire Alarm Repeater Panel
- Fire Alarm Interface Unit
- Wall Mounted Sounder
- Wall Mounted Sounder Beacon
- Automatic Opening Vent Control Panel
- Automatic Opening Vent
- Automatic Opening Vent Call Point
- Manual Opening Vent
- Dry Riser Landing Valve Outlet
- Dry Riser Inlet
- Wet Riser Landing Valve Outlet
- Wet Riser Inlet
- Water Tank
- CO2 Extinguisher
- Water Extinguisher
- Dry Powder Extinguisher
- Foam Extinguisher
- Wet Chemical Extinguisher
- Fire Blanket
- Fire Fighting Lift
- FD30s Fire Door
- FD60s Fire Door
- FD90s Fire Door
- Fire Resistant Glazing
- Emergency Light Unit
- Gas Shut Off Valve
- Electrical Distribution Board
- Electrical Intake Board
- Fire Hydrant
- Emergency Voice Comms
- EVCS Control Panel
- 30 Minutes Compartmentation
- 60 Minutes Compartmentation
- 90 Minutes Compartmentation
- 120 Minutes Compartmentation




Riverside Point
Radmarsh Road,
Lenton, Nottingham
NG7 2GJ

FIRST FLOOR

KEY

- Smoke Detector
- Smoke Detector Sounder
- Smoke Detector Sounder Beacon
- Heat Detector
- Heat Detector Sounder
- Heat Detector Sounder Beacon
- Multi-Sensor Detector
- Multi-Sensor Detector Sounder
- Fire Alarm Call Point
- Fire Alarm Beacon
- Fire Alarm Control Panel
- Fire Alarm Repeater Panel
- Fire Alarm Interface Unit
- Wall Mounted Sounder
- Wall Mounted Sounder Beacon
- Automatic Opening Vent Control Panel
- Automatic Opening Vent
- Automatic Opening Vent Call Point
- Manual Opening Vent
- Dry Riser Landing Valve Outlet
- Dry Riser Inlet
- Wet Riser Landing Valve Outlet
- Wet Riser Inlet
- Water Tank
- CO2 Extinguisher
- Water Extinguisher
- Dry Powder Extinguisher
- Foam Extinguisher
- Wet Chemical Extinguisher
- Fire Blanket
- Fire Fighting Lift
- FD30s Fire Door
- FD60s Fire Door
- FD90s Fire Door
- Fire Resistant Glazing
- Emergency Light Unit
- Gas Shut Off Valve
- Electrical Distribution Board
- Electrical Intake Board
- Fire Hydrant
- Emergency Voice Comms
- EVCS Control Panel
- 30 Minutes Compartmentation
- 60 Minutes Compartmentation
- 90 Minutes Compartmentation
- 120 Minutes Compartmentation

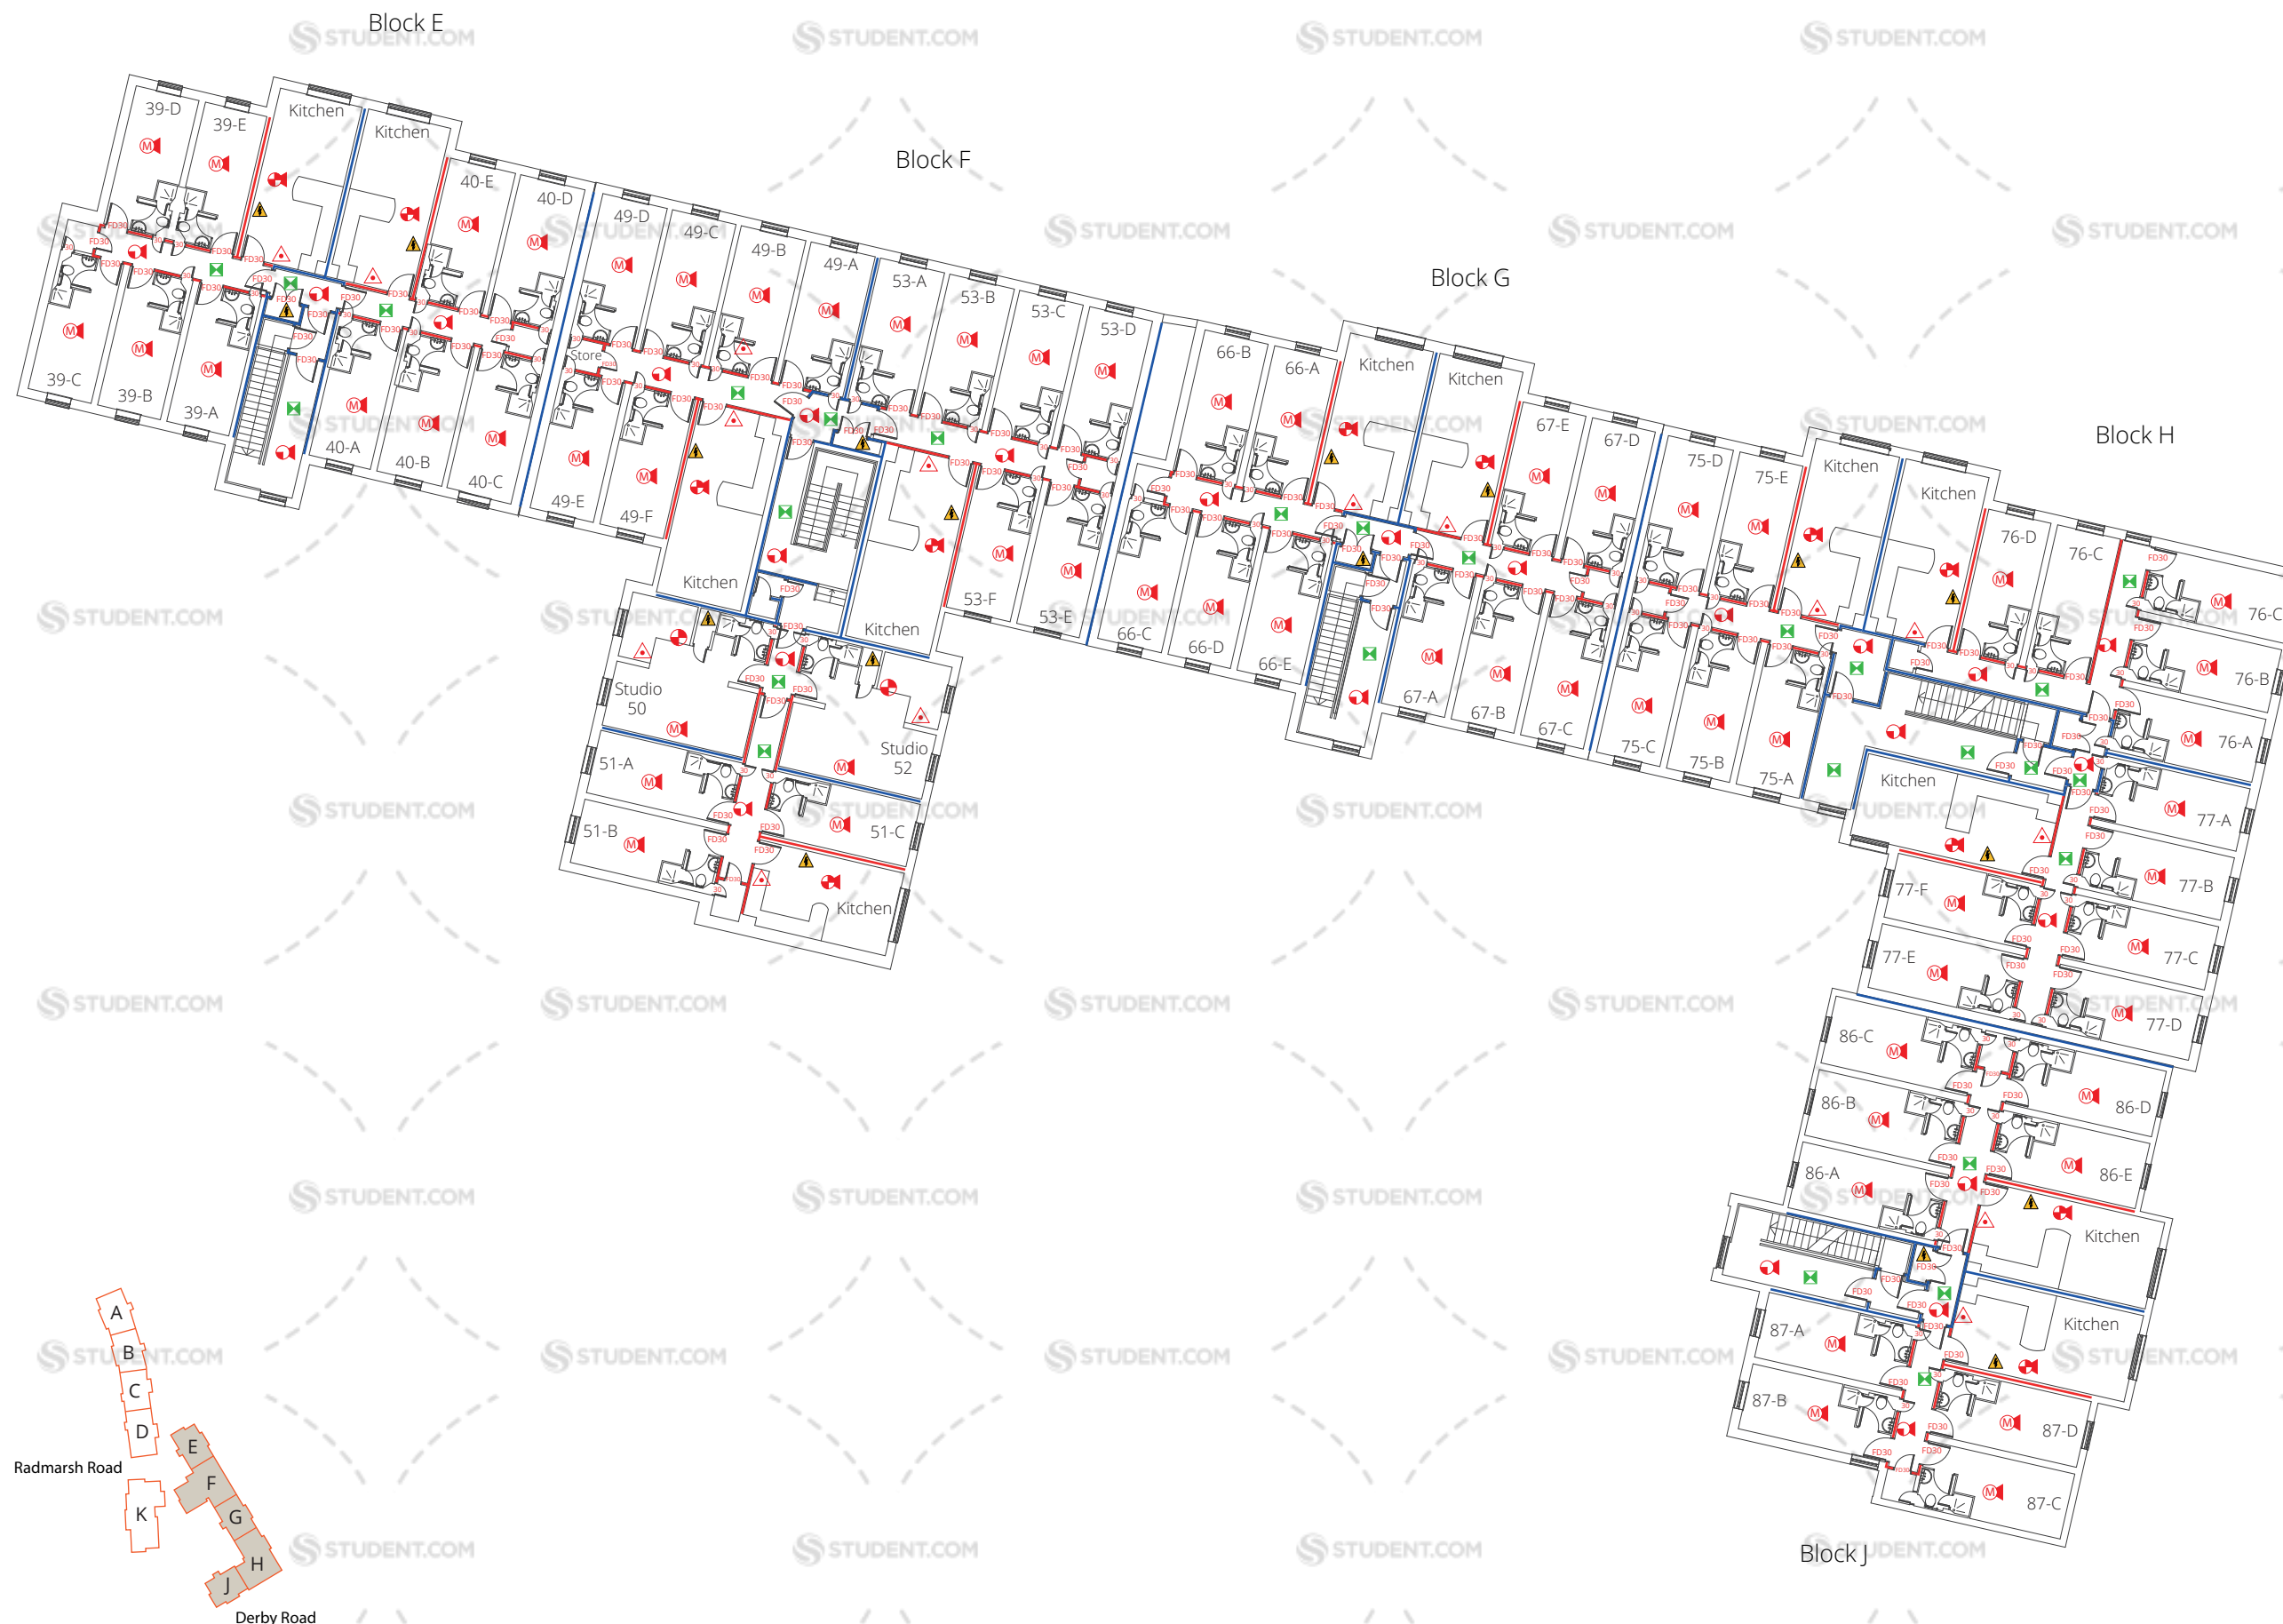

Riverside Point
Radmarsh Road,
Lenton, Nottingham
NG7 2GJ

SECOND FLOOR

KEY

- Smoke Detector
- Smoke Detector Sounder
- Smoke Detector Sounder Beacon
- Heat Detector
- Heat Detector Sounder
- Heat Detector Sounder Beacon
- Multi-Sensor Detector
- Multi-Sensor Detector Sounder
- Fire Alarm Call Point
- Fire Alarm Beacon
- Fire Alarm Control Panel
- Fire Alarm Repeater Panel
- Fire Alarm Interface Unit
- Wall Mounted Sounder
- Wall Mounted Sounder Beacon
- Automatic Opening Vent Control Panel
- Automatic Opening Vent
- Automatic Opening Vent Call Point
- Manual Opening Vent
- Dry Riser Landing Valve Outlet
- Dry Riser Inlet
- Wet Riser Landing Valve Outlet
- Wet Riser Inlet
- Water Tank
- CO2 Extinguisher
- Water Extinguisher
- Dry Powder Extinguisher
- Foam Extinguisher
- Wet Chemical Extinguisher
- Fire Blanket
- Fire Fighting Lift
- FD30s Fire Door
- FD60s Fire Door
- FD90s Fire Door
- Fire Resistant Glazing
- Emergency Light Unit
- Gas Shut Off Valve
- Electrical Distribution Board
- Electrical Intake Board
- Fire Hydrant
- Emergency Voice Comms
- EVCS Control Panel
- 30 Minutes Compartmentation
- 60 Minutes Compartmentation
- 90 Minutes Compartmentation
- 120 Minutes Compartmentation



Riverside Point
Radmarsh Road,
Lenton, Nottingham
NG7 2GJ

THIRD FLOOR

KEY

- Smoke Detector
- Smoke Detector Sounder
- Smoke Detector Sounder Beacon
- Heat Detector
- Heat Detector Sounder
- Heat Detector Sounder Beacon
- Multi-Sensor Detector
- Multi-Sensor Detector Sounder
- Fire Alarm Call Point
- Fire Alarm Beacon
- Fire Alarm Control Panel
- Fire Alarm Repeater Panel
- Fire Alarm Interface Unit
- Wall Mounted Sounder
- Wall Mounted Sounder Beacon
- Automatic Opening Vent Control Panel
- Automatic Opening Vent
- Automatic Opening Vent Call Point
- Manual Opening Vent
- Dry Riser Landing Valve Outlet
- Dry Riser Inlet
- Wet Riser Landing Valve Outlet
- Wet Riser Inlet
- Water Tank
- CO2 Extinguisher
- Water Extinguisher
- Dry Powder Extinguisher
- Foam Extinguisher
- Wet Chemical Extinguisher
- Fire Blanket
- Fire Fighting Lift
- FD30s Fire Door
- FD60s Fire Door
- FD90s Fire Door
- Fire Resistant Glazing
- Emergency Light Unit
- Gas Shut Off Valve
- Electrical Distribution Board
- Electrical Intake Board
- Fire Hydrant
- Emergency Voice Comms
- EVCS Control Panel
- 30 Minutes Compartmentation
- 60 Minutes Compartmentation
- 90 Minutes Compartmentation
- 120 Minutes Compartmentation




Riverside Point
Radmarsh Road,
Lenton, Nottingham
NG7 2GJ


BLOCK K

KEY


- Smoke Detector
- Smoke Detector Sounder
- Smoke Detector Sounder Beacon
- Heat Detector
- Heat Detector Sounder
- Heat Detector Sounder Beacon
- Multi-Sensor Detector
- Multi-Sensor Detector Sounder
- Fire Alarm Call Point
- Fire Alarm Beacon
- Fire Alarm Control Panel
- Fire Alarm Repeater Panel
- Fire Alarm Interface Unit
- Wall Mounted Sounder
- Wall Mounted Sounder Beacon
- Automatic Opening Vent Control Panel
- Automatic Opening Vent
- Automatic Opening Vent Call Point
- Manual Opening Vent
- Dry Riser Landing Valve Outlet
- Dry Riser Inlet
- Wet Riser Landing Valve Outlet
- Wet Riser Inlet
- Water Tank
- CO2 Extinguisher
- Water Extinguisher
- Dry Powder Extinguisher
- Foam Extinguisher
- Wet Chemical Extinguisher
- Fire Blanket
- Fire Fighting Lift
- FD30s Fire Door
- FD60s Fire Door
- FD90s Fire Door
- Fire Resistant Glazing
- Emergency Light Unit
- Gas Shut Off Valve
- Electrical Distribution Board
- Electrical Intake Board
- Fire Hydrant
- Emergency Voice Comms
- EVCS Control Panel
- 30 Minutes Compartmentation
- 60 Minutes Compartmentation
- 90 Minutes Compartmentation
- 120 Minutes Compartmentation

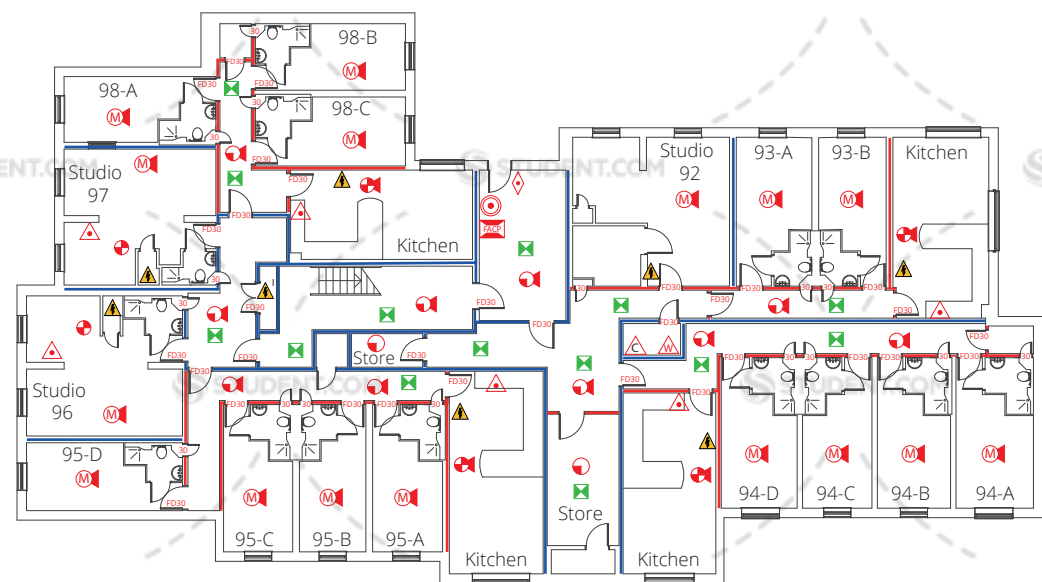


GROUND FLOOR

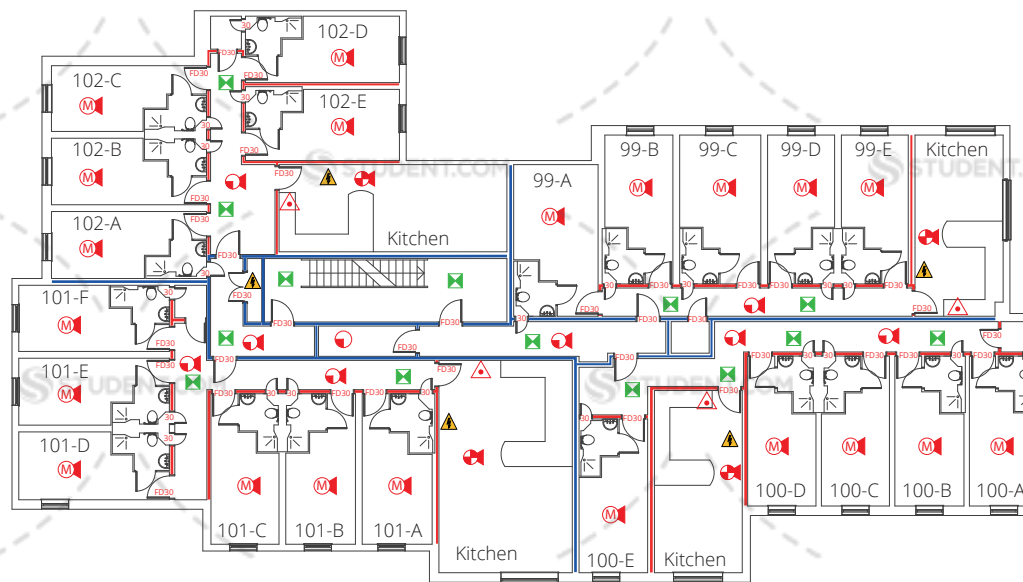

FIRST FLOOR

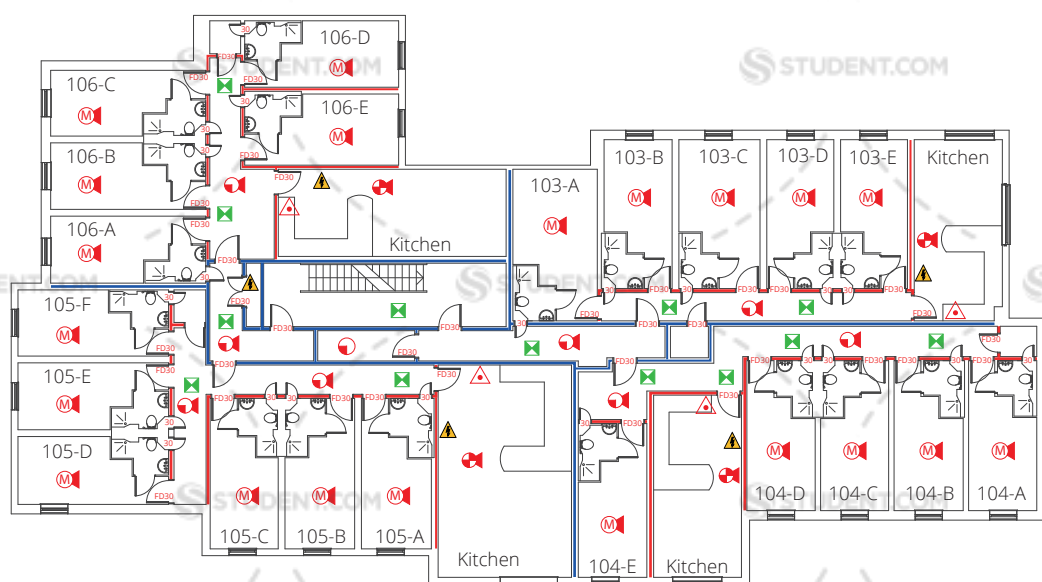

SECOND FLOOR

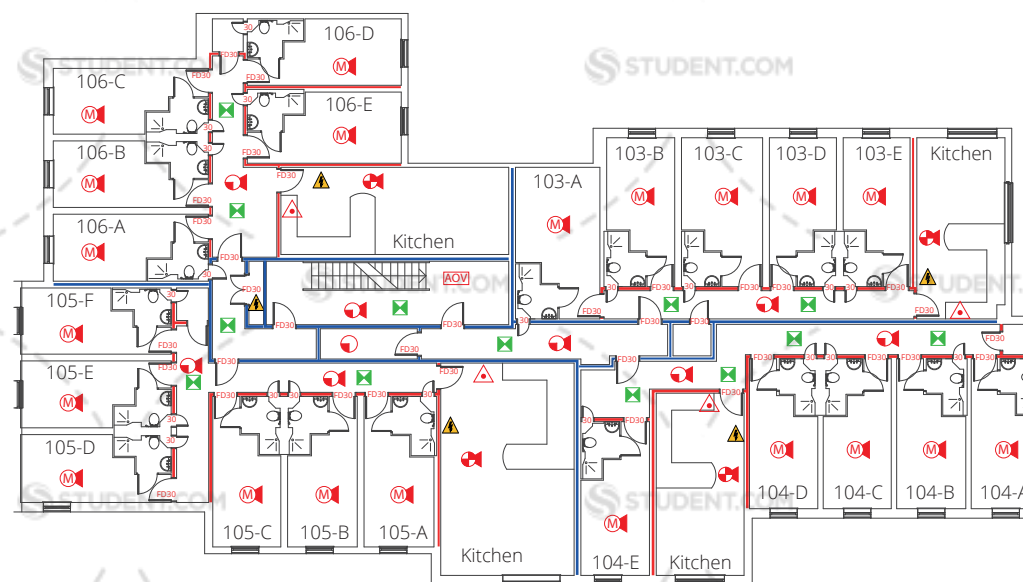

THIRD FLOOR

